

-  Colusa Subbasin
-  Active Public Water Supply Well
- Representative Groundwater Quality Monitoring Network Well**
-  Representative Public Water Supply Well
-  Representative California Rice Commission Groundwater Monitoring Well
-  Representative Sacramento Valley Water Quality Coalition Groundwater Monitoring Well

Colusa Groundwater Authority
and Glenn Groundwater Authority
Colusa Subbasin
Groundwater Sustainability Plan

Figure 5D-7. Maxwell Public Utility District Representative Well:
Well 0610003-003 (Well 4)

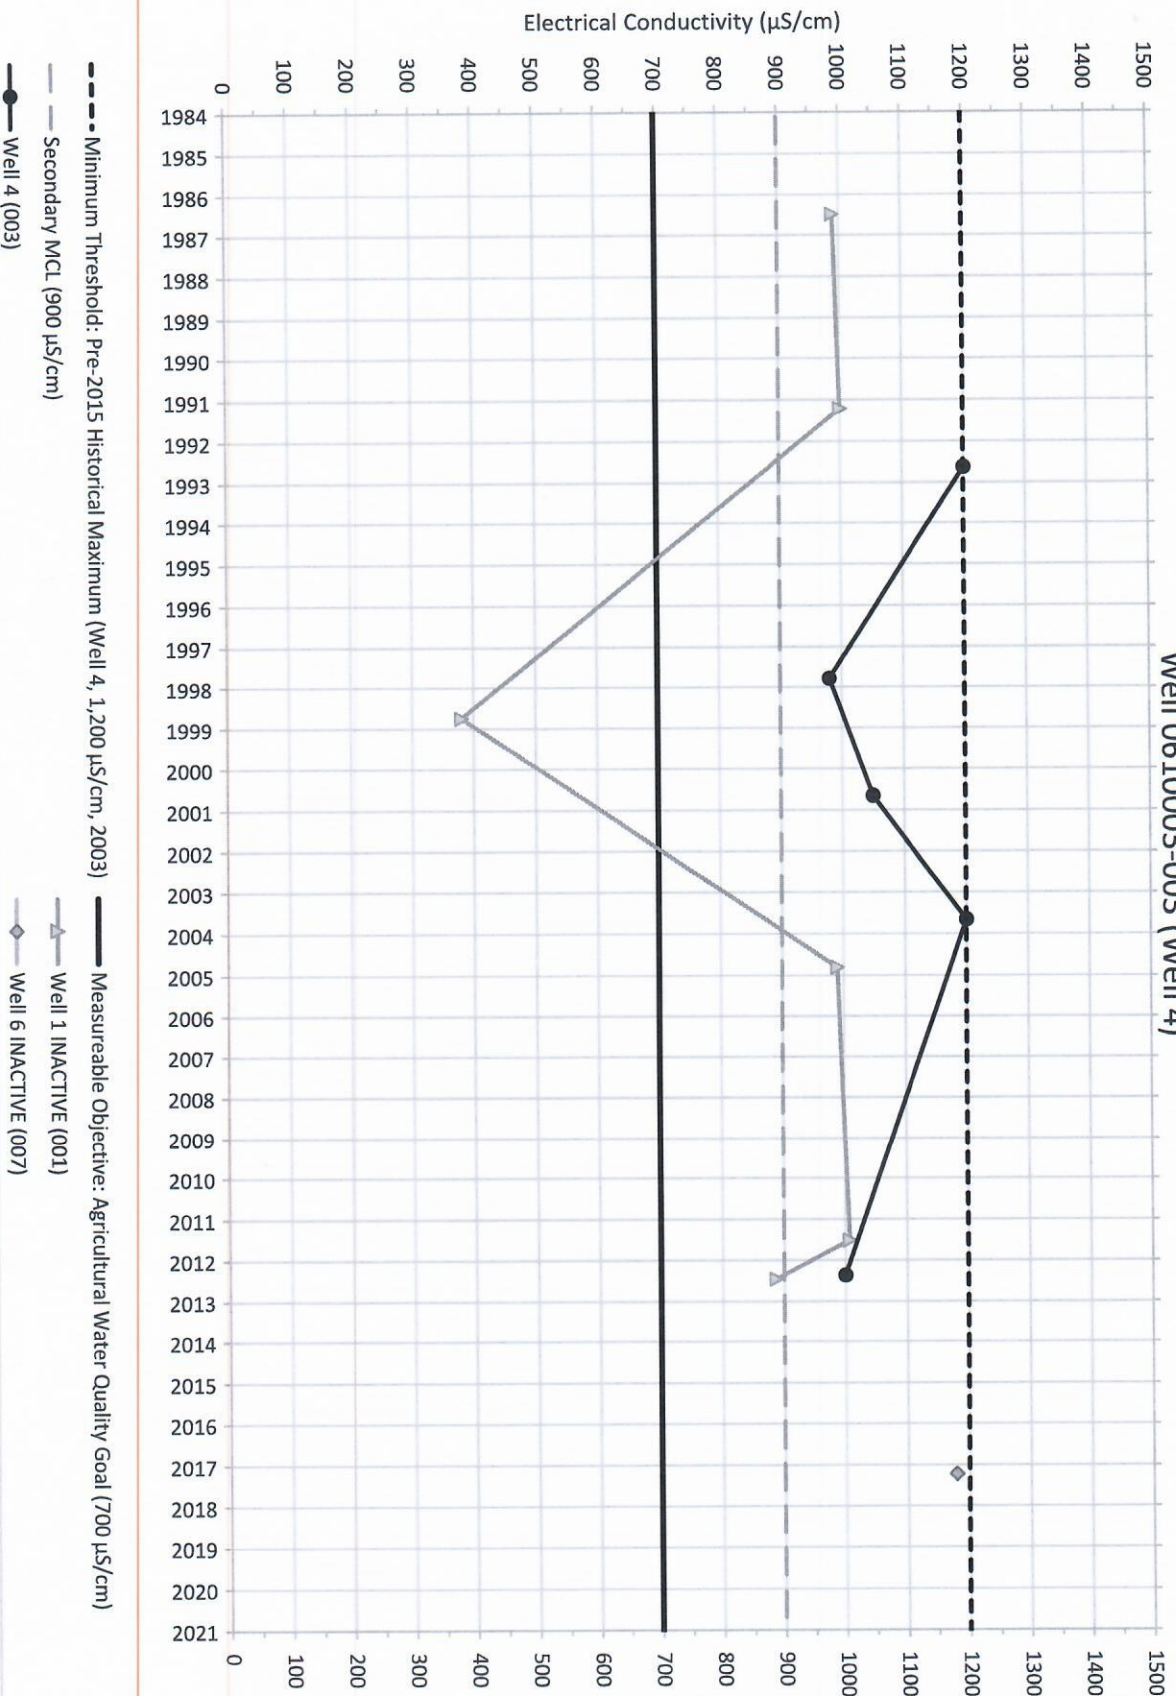


Figure 5D-9. City of Williams Representative Well:
Well 0610004-004 (Well 8)

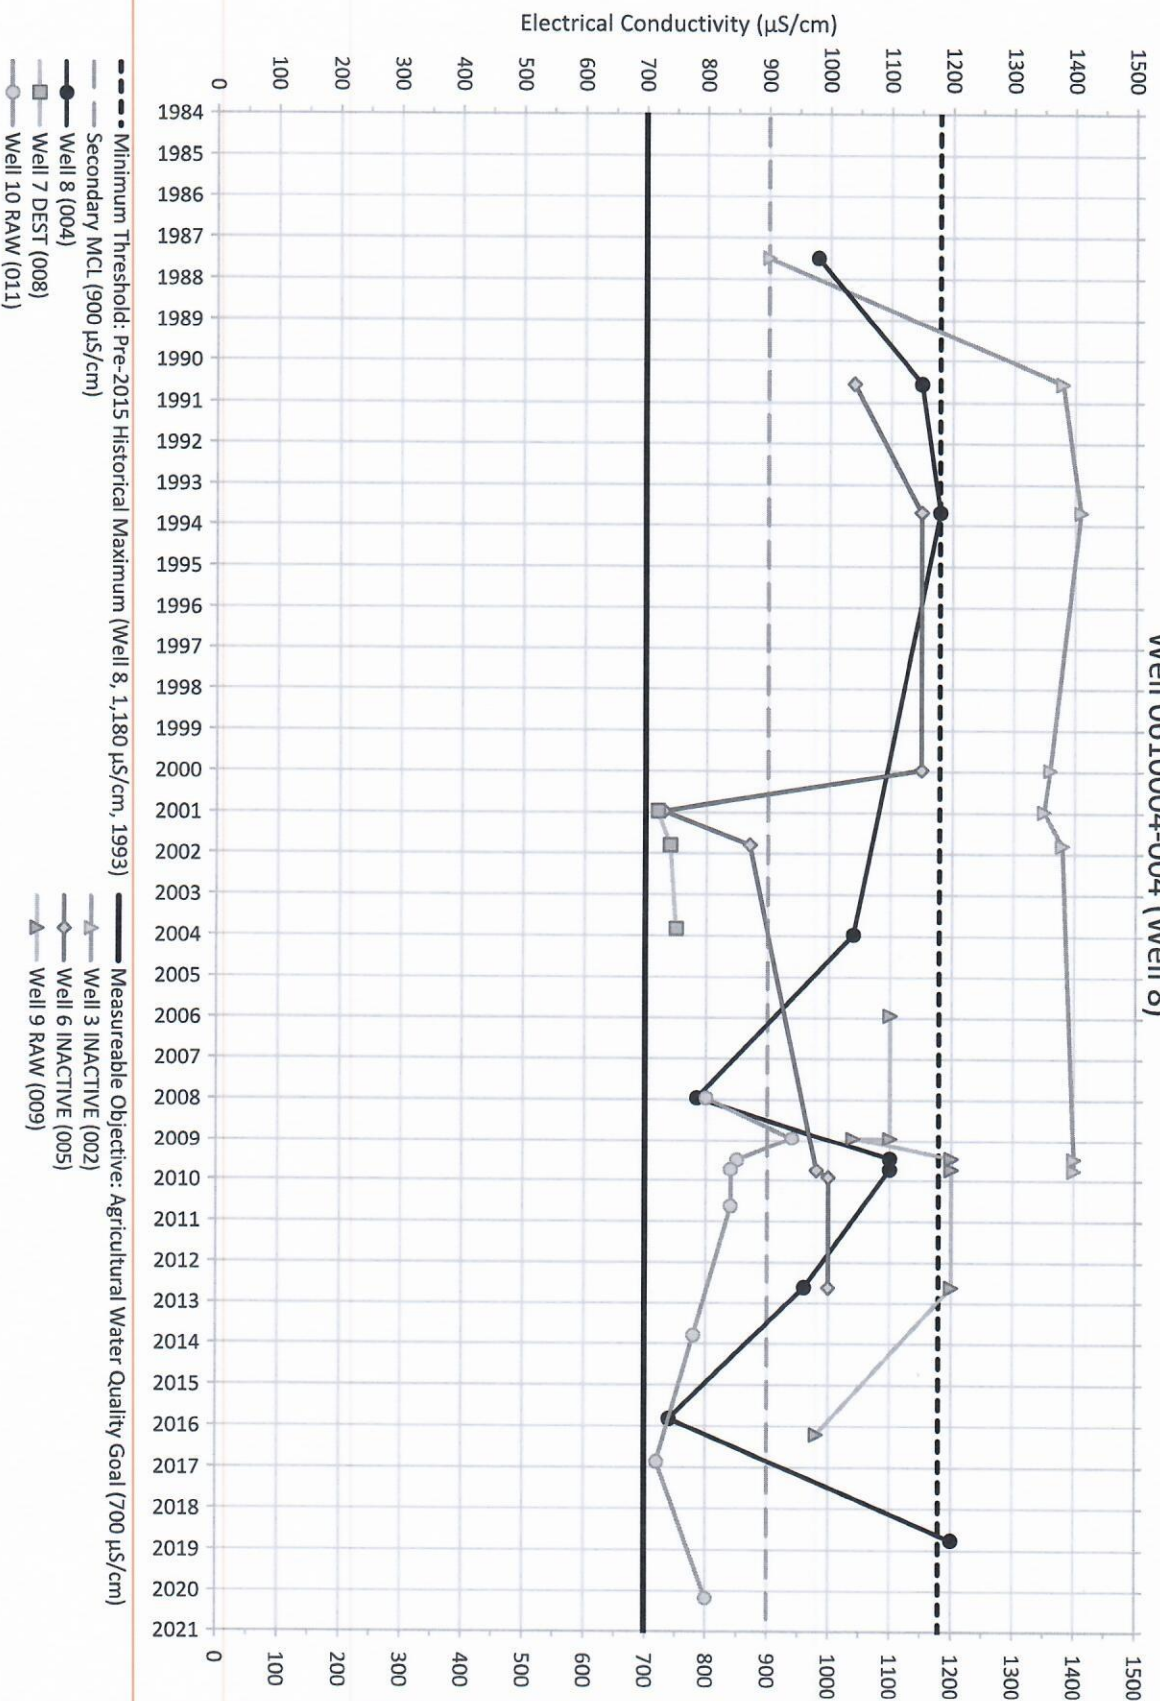


Figure 5D-19. Electrical Conductivity: CRC Well 14G1M (Screened Depth: 25-30 ft)

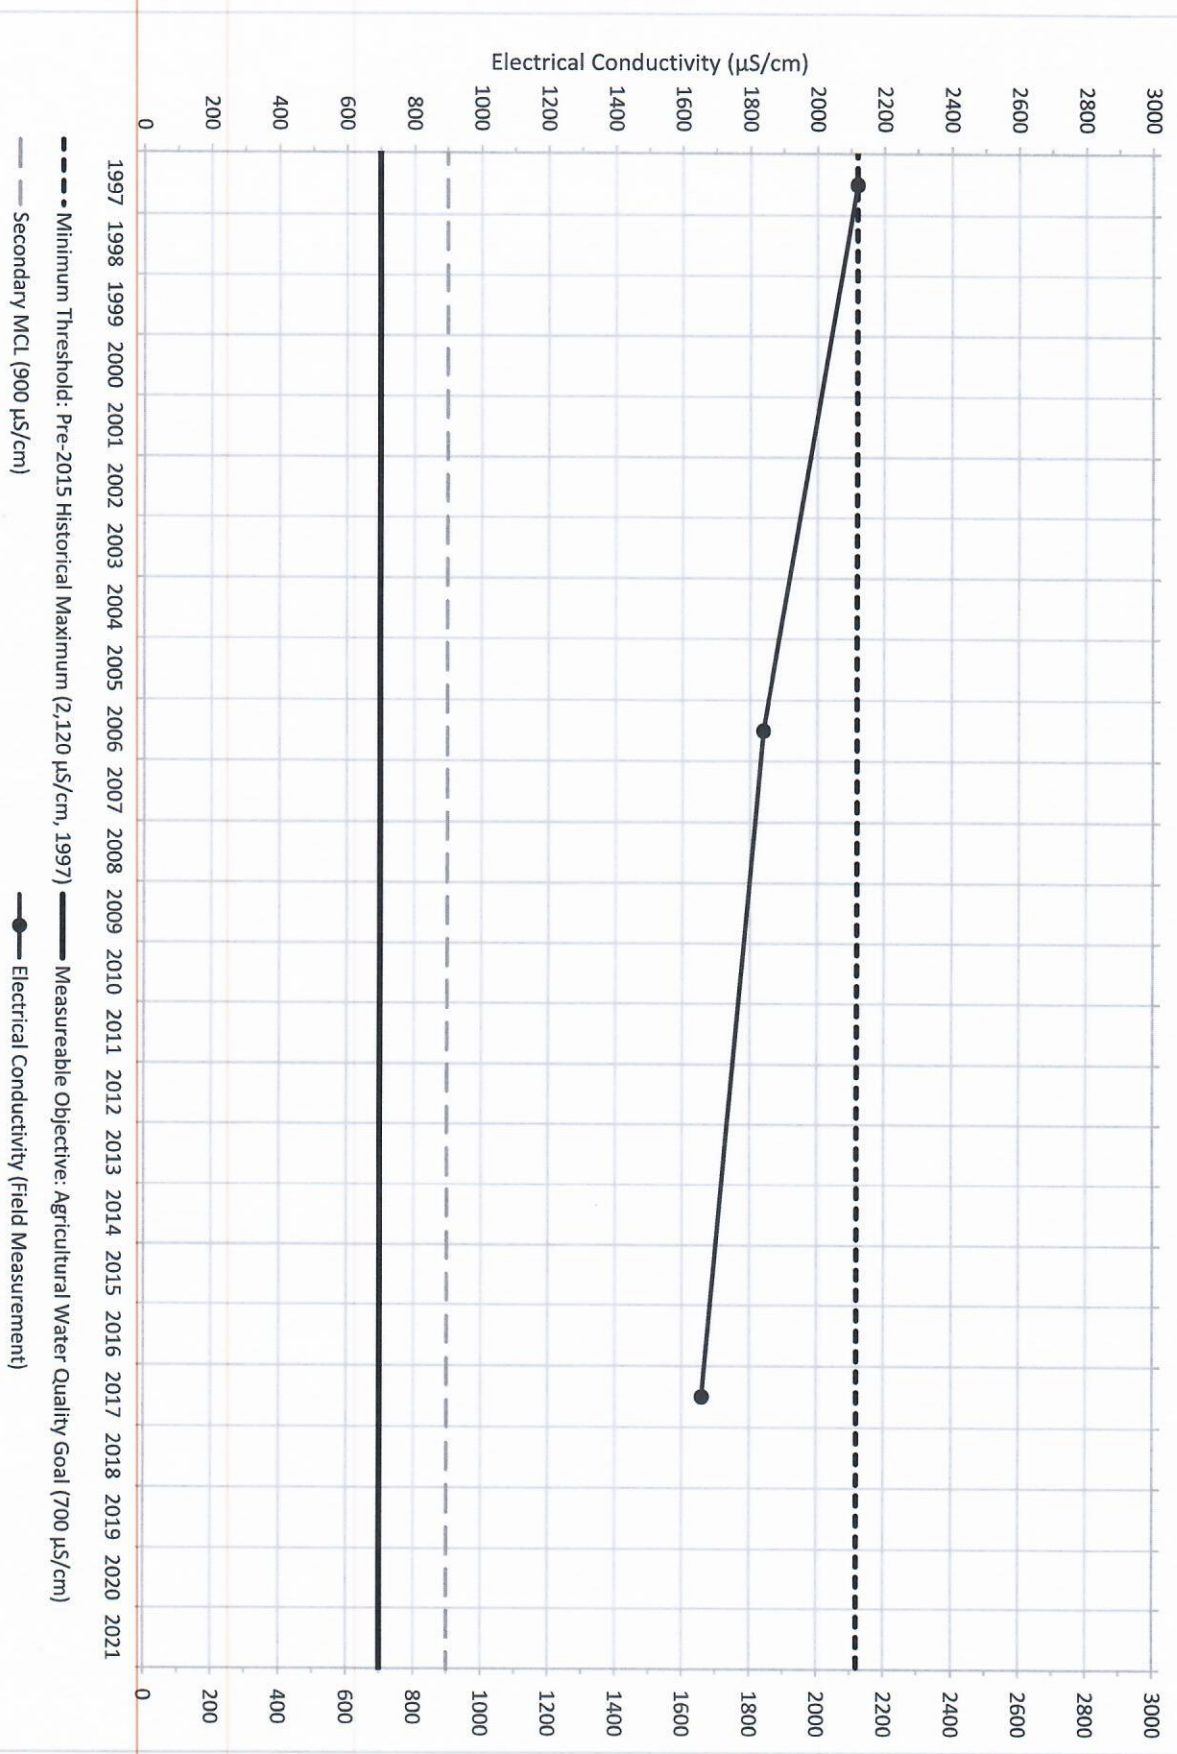


Figure 5D-20. Electrical Conductivity: CRC Well 35M1M (Screened Depth: 25-30 ft)

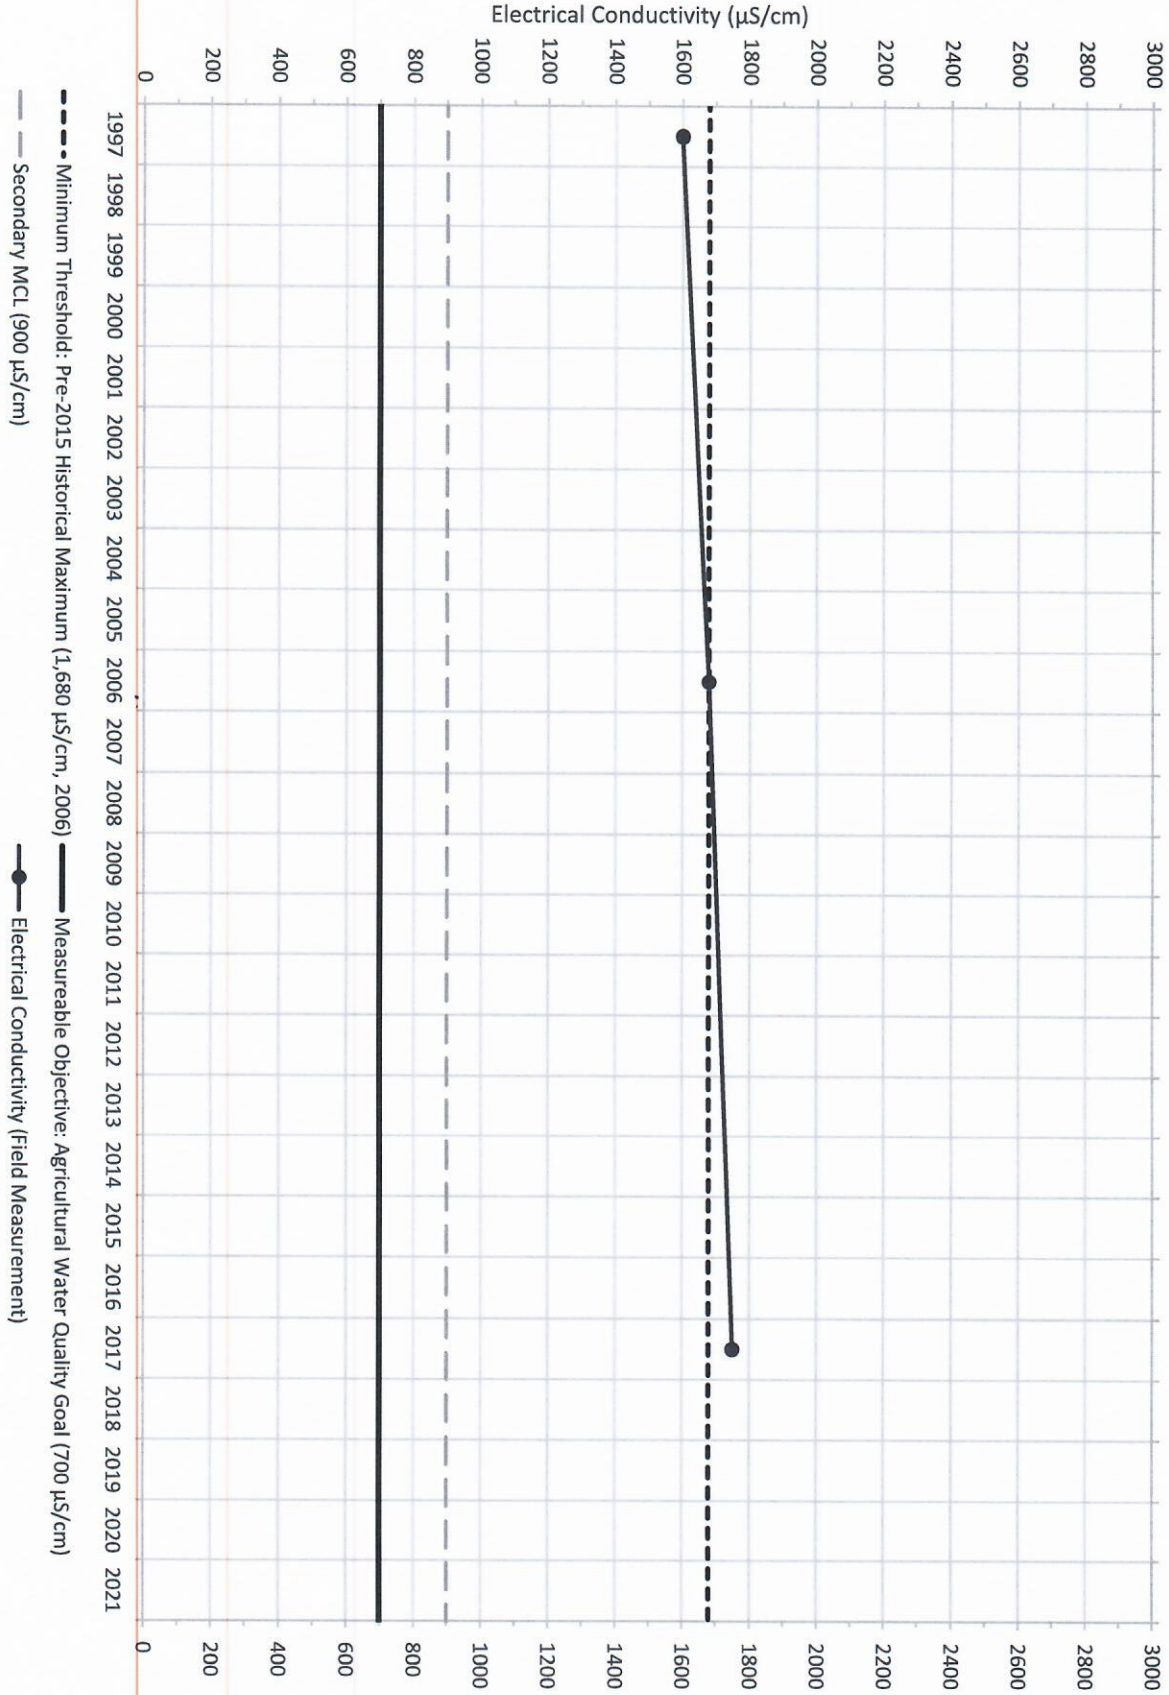


Figure 5D-21. Electrical Conductivity: CRC Well 03E1M (Screened Depth: 25-30 ft)

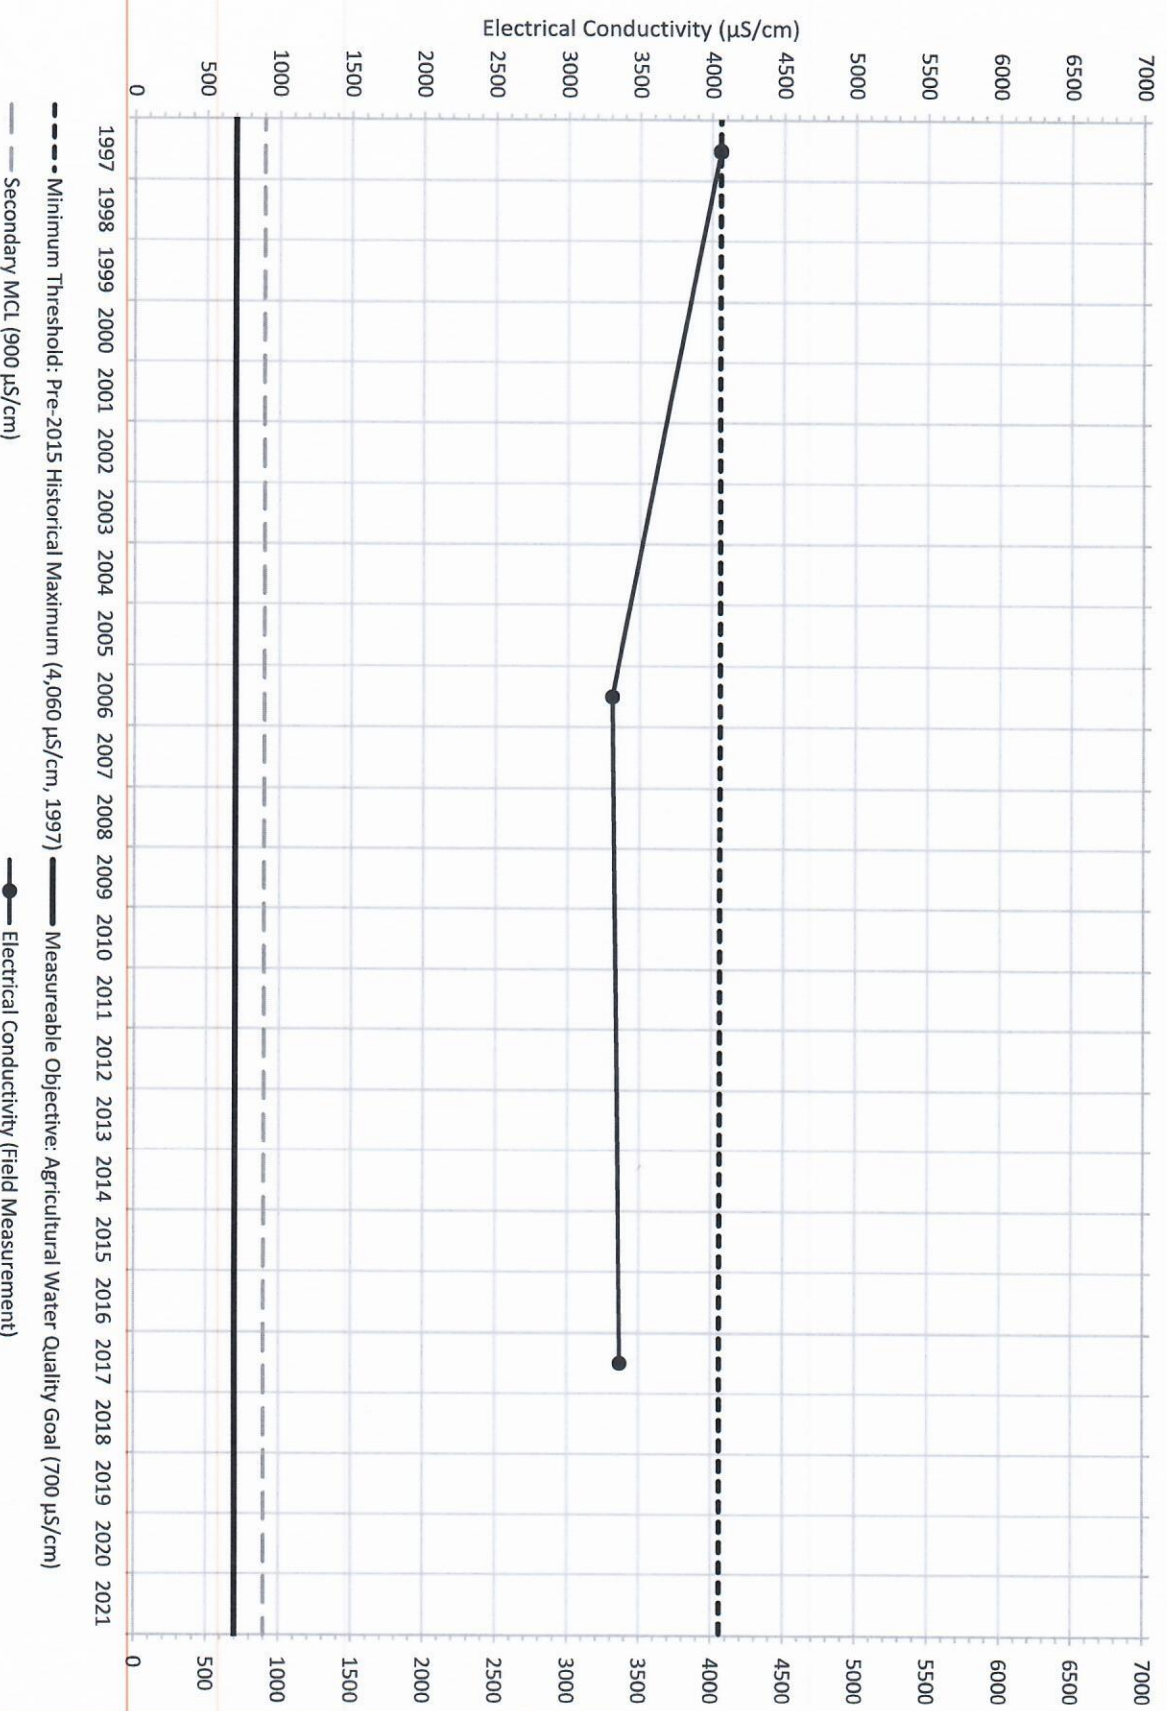


Figure 5D-22. Electrical Conductivity: CRC Well 16R1M (Screened Depth: 25-30 ft)

